

2025 JUN 24

# Isolating Source Contributions

---

David A. Nelson

Fellow, Institute of Noise Control Engineering

Principal Consultant

Nelson Acoustics

[www.nelsonacoustical.com](http://www.nelsonacoustical.com)

# Methods for Isolating the Source

---

- Measurements and Mathematics:
  - Measure the “neighborhood residual” - everything but the Source
  - Measure the “total sound” – everything including the Source
  - Use decibel subtraction to determine the Source contribution
    - Note: the level difference must be  $\geq 3$  dB to do the subtraction per ANSI standard
- Behind Barrier
  - Estimate the neighborhood residual by measuring behind the residence or other structure that blocks the Source
- Similar Neighborhood
  - Estimate the neighborhood residual by measuring at the same distance from a nearby roadway but much farther from the Source

# Summary

Source	Method	LpA,eq	LpC,eq	31.5	63	125	250	500	1000	2000	4000	8000	
Hornbaker	Behind Barrier, Location A	OK	OK	OK	OK	+4	OK	OK	+7	+6	+2	---	Data Center out of compliance
Hornbaker	Behind Barrier Location B	OK	OK	---	---	OK	OK	OK	OK	OK	OK	---	Secondary sources ruled out
Wellington Glen	Behind Barrier	OK	OK	OK	OK	---	OK	OK	---	OK	---	---	< 3 dB differences
Novant Hospital	Along Roadway	OK	OK	OK	OK	OK	OK	+0	+1	OK	---	---	Just out of compliance - may be traffic
Marsteller School	Along Roadway	OK	OK	OK	OK	OK	OK	OK	OK	OK	+12	+8	Bugs, otherwise Compliant
10224 Winged Elm	Backyard - Frontyard	OK	OK	OK	+2	+1	OK	+0	+2	OK	OK	---	Data Center out of compliance
10224 Winged Elm	Along Roadway vs Frontyard	OK	OK	OK	+2	+1	OK	+0	+2	OK	---	---	Data Center out of compliance
10224 Winged Elm	Property Line - Frontyard	OK	OK	OK	+1	+1	OK	+0	OK	---	OK	---	Property Line levels < Backyard Levels

## KEY:

OK	Source ≤ Criterion
---	Source not measurable
+X	Source > Criterion by X dB
	Out of Compliance
	Biogenic Noise ("Bugs")

# Hornbaker

Source	Description	Start Time	LpA,eq	LpC,eq	LpF,50								
					31.5	63	125	250	500	1000	2000	4000	8000
Hornbaker	Property Line, South End of Bldg	6/10/25 00:54	49	63	61	59	57	48	42	44	40	35	24
Hornbaker	Behind Barrier	6/10/25 01:08	45	61	58	57	55	46	39	38	34	31	27
	Net Apparent Source Contribution		46	59	57	54	54	43	39	43	39	33	---
	Night Criterion		47	60	63	55	50	45	40	36	33	31	30
	Compliance Status		OK	OK	OK	OK	+4	OK	OK	+7	+6	+2	---


Total Sound (solid line)

Residual Sound (dashed line)

Apparent Source Contribution (circles)

Criterion (bars)

If circle > bar, out of compliance

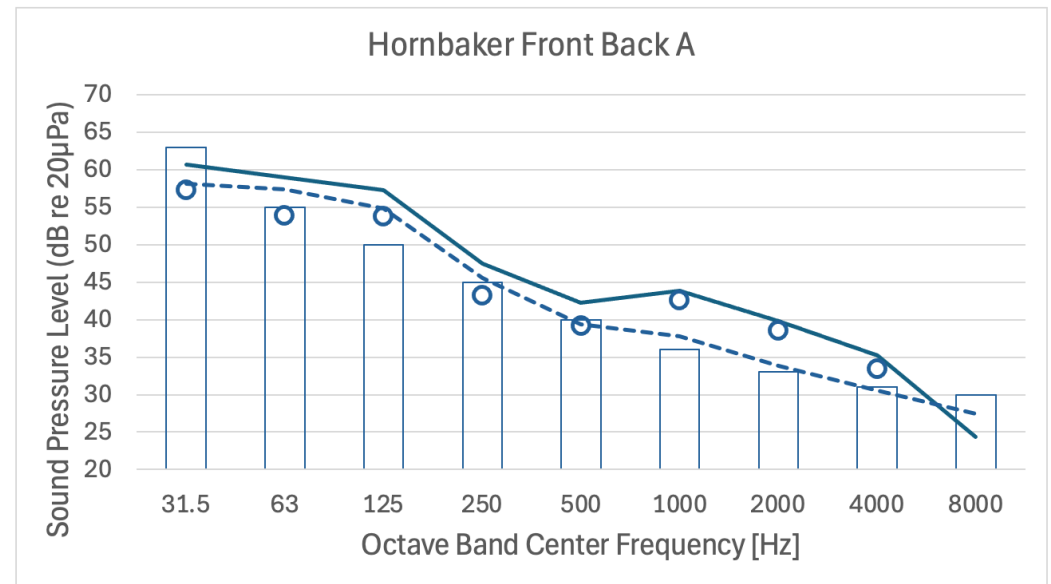


# Wellington Glen (Iron Mountain)

Source	Description	Start Time	LpA,eq	LpC,eq	LpF,50								
					31.5	63	125	250	500	1000	2000	4000	8000
Wellington Glen	Facing Data Center	6/10/25 01:54	46	61	55	59	51	45	42	39	35	31	22
Wellington Glen	In Courtyard	6/10/25 02:06	45	60	53	59	52	44	42	40	35	31	25
Net Apparent Source Contribution			34	51	50	52	---	37	31	---	19	---	---
Night Criterion			47	60	63	55	50	45	40	36	33	31	30
Compliance Status			OK	OK	OK	OK	---	OK	OK	---	OK	---	---

All Level differences < 3 dB  
Source contribution not accurate  
In compliance at the moment

However past measurements  
indicated a strong low-frequency tone  
that would have been out of  
compliance

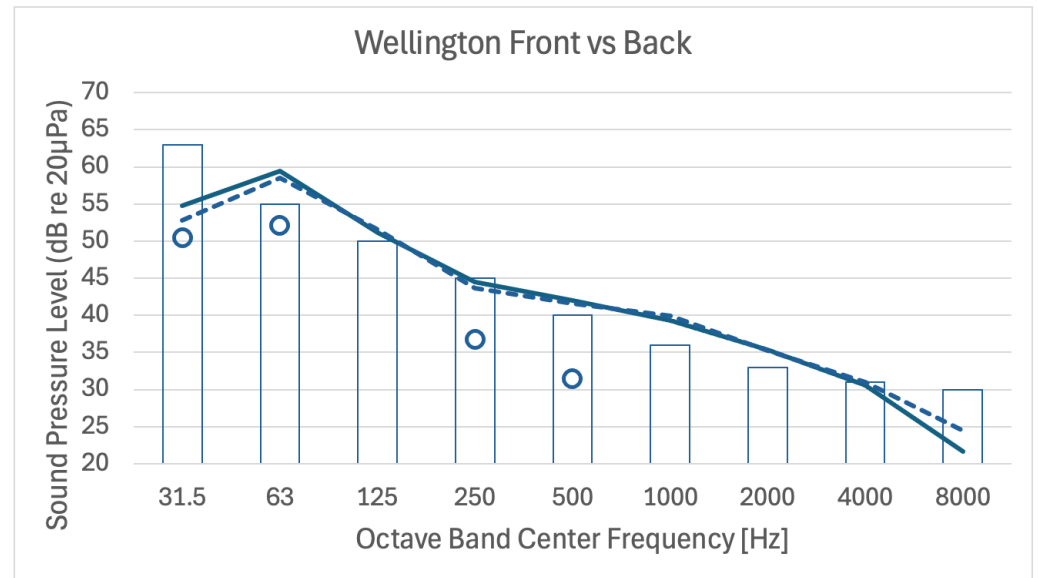

# Novant Hospital


Source	Description	Start Time	LpF,50										
			LpA,eq	LpC,eq	31.5	63	125	250	500	1000	2000	4000	8000
Novant Health	Property Line	6/10/25 02:47	45	58	54	54	49	44	41	39	33	26	18
Novant Health	Along Highway similar Distance	6/10/25 02:32	40	55	51	53	48	41	34	35	27	27	21
	Net Apparent Source Contribution		43	53	51	47	45	41	40	37	31	---	---
	Night Criterion		47	60	63	55	50	45	40	36	33	31	30
	Compliance Status		OK	OK	OK	OK	OK	OK	+0	+1	OK	---	---

Large distance to along highway point

Several roadways in the area


The Total sound at the property line may include “extra” traffic noise not included in the residual

Additional measurements recommended

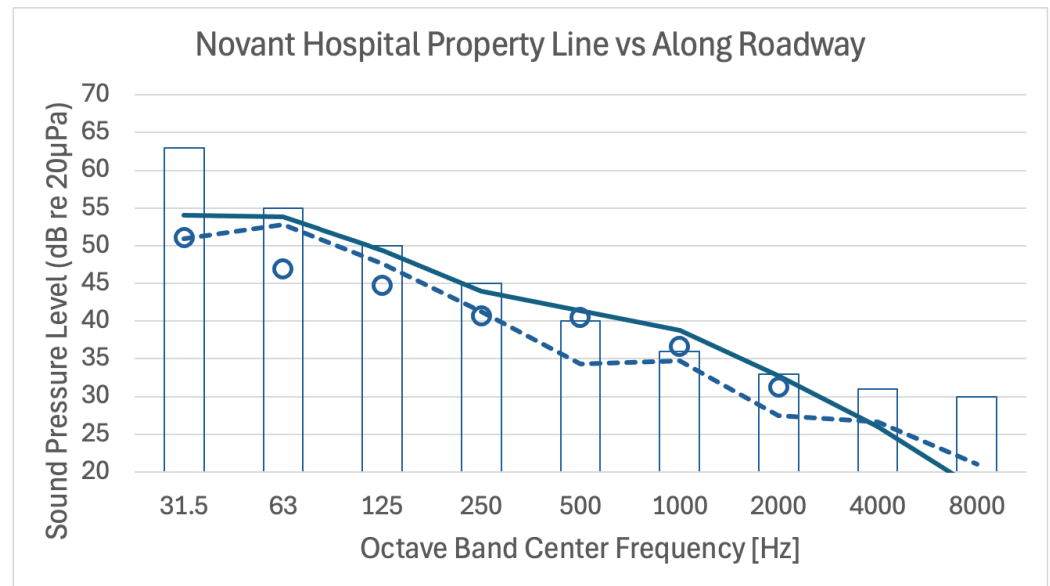

# Novant Hospital – extrapolate from cooling towers

- A measurement relatively near the Cooling Towers
- Extrapolate to property line
  - Buildings and other potential noise sources nearby
- Cooling Tower contribution estimate in red circles
- Cooling Tower does not appear to be the source of the 500 and 1000 Hz exceedance

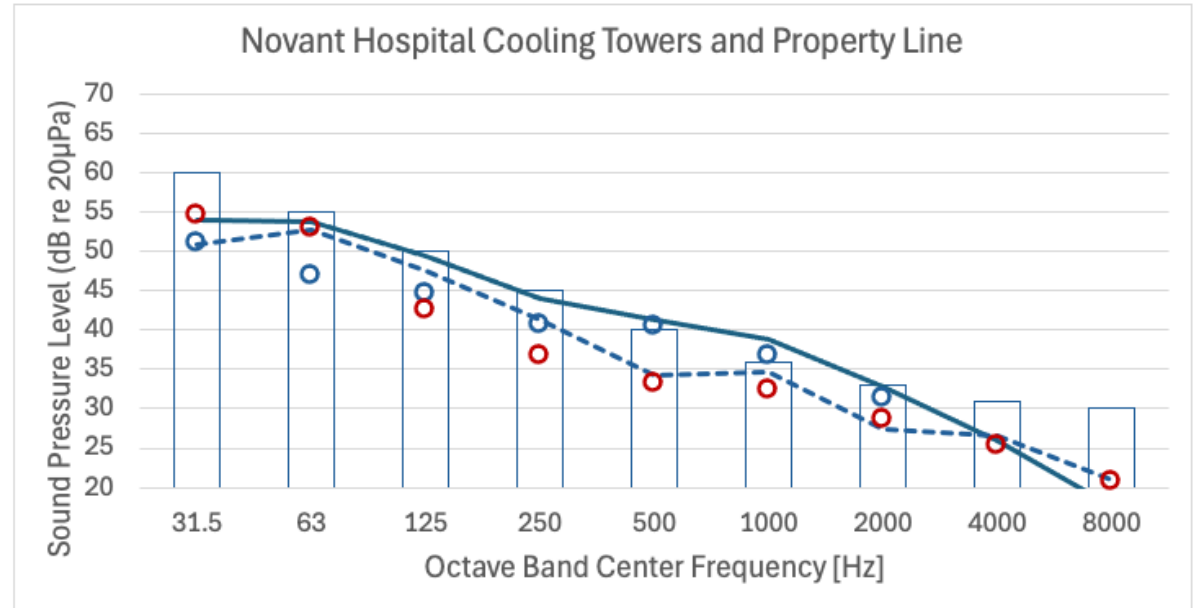


# Marsteller School rooftop HVAC equipment

Source	Description	Start Time	LpF,50												LpA',50
			LpA,eq	LpC,eq	31.5	63	125	250	500	1000	2000	4000	8000		
Marsteller School	Property Line beside water tower	6/10/25 03:39	46	51	46	45	43	42	32	36	29	43	38	39	
Marsteller School	Across Road similar distance	6/10/25 03:24	31	44	39	41	37	29	24	22	19	22	22	27	
	Net Apparent Source Contribution		46	50	45	43	42	42	31	35	28	43	38		
		Night Criterion	47	60	63	55	50	45	40	36	33	31	30		
		Compliance Status	OK	OK	OK	OK	OK	OK	OK	OK	OK	+12	+8		

Significant bugs in 4000 and 8000  
possibly 1000 as well

Surprisingly low levels for residual

In compliance at all remaining bands

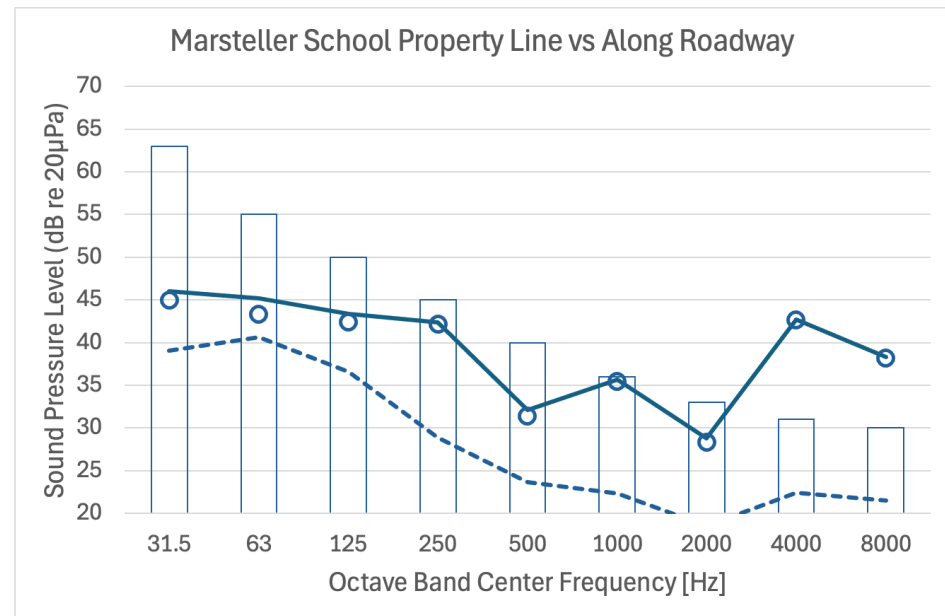



# 10224 Winged Elm – Backyard at Ground Level

Source	Description	Start Time	LpF,50										
			LpA,50	LpC,50	31.5	63	125	250	500	1000	2000	4000	8000
AWS DC	Backyard 10224 Winged Elm Cir	6/12/25 04:06	44	60	57	58	52	44	42	40	30	18	13
Along Roadway	GlenCrest and SunnySlope	6/12/25 03:25	40	53	48	52	46	39	37	35	29	26	22
	Net Apparent Source Contribution		42	59	57	57	51	42	40	38	20	---	---
	Night Criterion		47	60	63	55	50	45	40	36	33	31	30
	Compliance Status		OK	OK	OK	+2	+1	OK	+0	+2	OK	---	---


Behind Barrier and Along Roadway methods gave identical results

VRE was active during measurement

VRE 90 Hz tone and harmonics removed by signal processing

Other VRE noises may remain

Re-measurement recommended

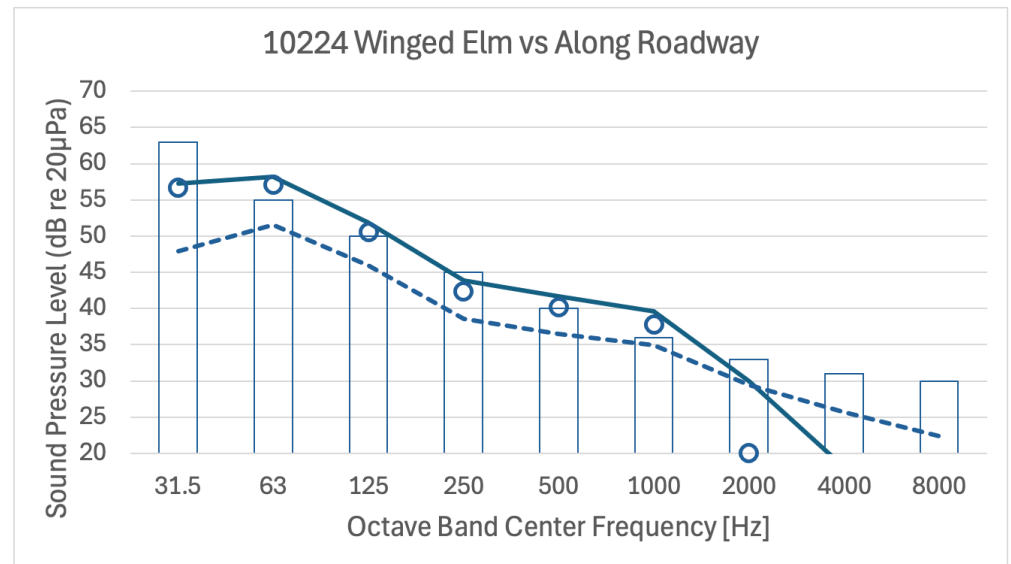


# 10224 Winged Elm – Property Line

Source	Description	Start Time	LpF,50										
			LpA,50	LpC,50	31.5	63	125	250	500	1000	2000	4000	8000
AWS DC	Property Line	6/12/25 03:55	43	59	56	57	52	43	42	36	27	17	13
AWS DC	Front Driveway 10224 Winged Elm Cir	6/12/25 03:42	39	53	48	50	46	39	36	35	27	16	13
	Net Apparent Source Contribution		41	58	55	56	51	40	40	31	---	5	---
	Night Criterion		47	60	63	55	50	45	40	36	33	31	30
	Compliance Status		OK	OK	OK	+1	+1	OK	+0	OK	---	OK	---

Property Line levels < Backyard Levels  
despite lesser distance

Suggests acoustic shadow of building  
reducing levels of rooftop equipment

Recommend re-measurement 25' from  
back of house at height of 2<sup>nd</sup> story  
window

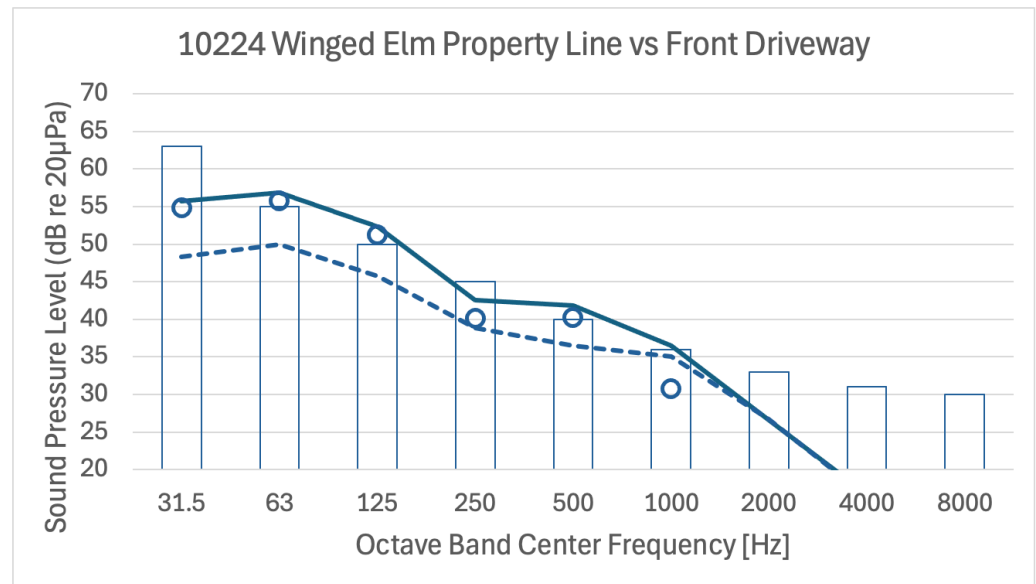


# Est'd Sound Levels inside 10224 Winged Elm

- Start from Source sound levels
  - $L_{pA, outdoor} \approx 42$ , below WHO recommendation of 45
- Subtract typical noise reduction (NR) of wood-frame residence
- Evaluate interior sound spectrum
  - $L_{pA, indoor} \approx 21$ , well below WHO recommendation of 30
  - NC rating is below 15, which is appropriate for broadcast studios
  - NC 25 is considered compatible with residential bedrooms

	16	31.5	63	125	250	500	1000	2000	4000	A	C	NC
Residual	55	57	57	51	42	40	38	27	13			
Typical House NR	8	11	15	19	21	23	25	25	25			
Net Indoors	47	46	42	32	21	17	13	2	-12	21	46	11

# Audibility of Interior Levels

- The “average” listener (P50) would be able to detect the presence of the sound at 63 Hz and above in an otherwise silent background
- Sensitive listeners (P10) might also be able to detect the 31.5 Hz band as well (depending on spectrum)
- The difference between sound levels with and without the source would also be detectable

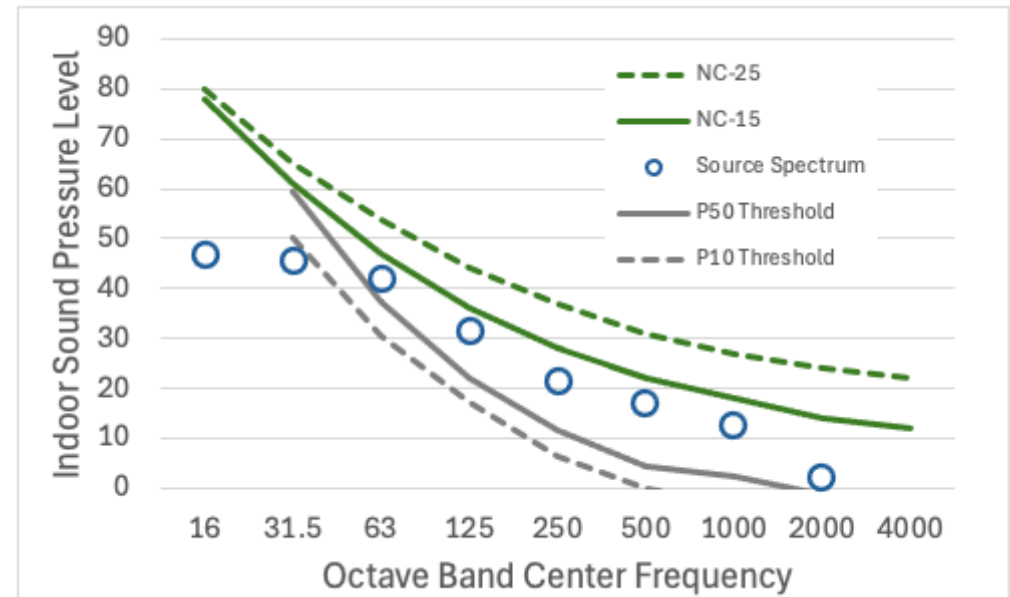

# Effect of Interior Levels

---

- Outdoor levels are well below those needed to create perceptible structural vibration
  - Even when combined with the neighborhood residual
- Example reasons why these levels could nevertheless be experienced as “loud”:
  - A listener has involuntarily learned to focus on it
  - A listener has exceptionally sensitive hearing
  - Structural resonances are present:
    - in walls, can increase sound levels particularly in the 16 Hz band
    - in windows, can increase sound levels up to and including the 125 Hz band
  - Room acoustic resonances are present:
    - can increase tonal sound levels from the 31.5 Hz to the 125 Hz band, inclusive